



**US Army Corps
of Engineers®**
Engineer Research and
Development Center

Energetic Residues from Blow-in-Place Detonation of 60-mm and 120-mm Fuzed High-Explosive Mortar Cartridges

Michael R. Walsh, Charles M. Collins, and Alan D. Hewitt

October 2008



COVER: Explosive Ordnance Disposal (EOD) specialist from the 716th EOD detachment wiring up the initiator for a 120-mm high-explosive projectile, Eagle River Flats, Fort Richardson, AK, February 2008.
(Image by Michael R. Walsh, CRREL).

Energetic Residues from Blow-in-Place Detonation of 60-mm and 120-mm Fuzed High-Explosive Mortar Cartridges

Michael R. Walsh, Charles M. Collins, and Alan D. Hewitt

*Cold Regions Research and Engineering Laboratory
U.S. Army Engineer Research and Development Center
72 Lyme Road
Hanover, NH 03755-1290*

Final report

Approved for public release; distribution is unlimited.

Prepared for U.S. Army Garrison, Alaska, Soil and Water Monitoring Program, and
Strategic Environmental Research and Development Program (SERDP),
Arlington, VA Project ER-1481

Abstract: Military live-fire training missions frequently result in unexploded ordnance on training ranges. Disposal of the rounds, often done in situ, is necessary in some cases for range safety or maintenance. In February 2008, the U.S. Army Cold Regions Research and Engineering Laboratory teamed with the 716th Explosive Ordnance Disposal detachment at Fort Richardson, AK, to detonate two series of seven 60-mm and 120-mm fuzed high-explosive (HE) rounds to determine the resulting energetic residues. Each round was detonated using a single block of C4 (91% RDX) as a donor charge. All rounds were separated to allow each detonation plume to be sampled as a distinct decision unit. Samples were collected from the snow surface using multi-increment sampling for residues analysis. The 60-mm plumes averaged 200 mg of HE, 0.022% of the original mass. The 120-mm plumes averaged 25 mg of HE, $7.1 \times 10^{-4}\%$ of the original mass. Quality assurance procedures were conducted both in the field and at the laboratory to ensure data fidelity.

DISCLAIMER: The contents of this report are not to be used for advertising, publication, or promotional purposes. Citation of trade names does not constitute an official endorsement or approval of the use of such commercial products. All product names and trademarks cited are the property of their respective owners. The findings of this report are not to be construed as an official Department of the Army position unless so designated by other authorized documents.

DESTROY THIS REPORT WHEN NO LONGER NEEDED. DO NOT RETURN IT TO THE ORIGINATOR.

Contents

| | |
|---|------------|
| Figures and Tables | iv |
| Preface | v |
| Unit Conversion Factors | vi |
| Nomenclature | vii |
| 1 Introduction | 1 |
| 2 Field Tests | 3 |
| Field site | 3 |
| Munitions | 4 |
| Tests | 4 |
| Sample processing and analysis | 7 |
| Quality assurance procedures | 9 |
| 3 Results | 10 |
| Baseline samples | 10 |
| BIP detonation plumes | 10 |
| 4 Discussion | 16 |
| 5 Conclusions | 18 |
| References | 19 |
| Appendix A: Munitions Data | 21 |
| Appendix B: 120-mm Data | 22 |
| Appendix C: 60-mm Data | 25 |
| Appendix D: Laboratory QA Data | 28 |
| Report Documentation Page | |

Figures and Tables

Figures

| | |
|--|----|
| Figure 1. Eagle River Flats impact area in winter. | 3 |
| Figure 2. Ice road to BIP sites from ERF access road. | 4 |
| Figure 3. Munitions used in BIP tests..... | 6 |
| Figure 4. Sample filtration setup. | 8 |
| Figure 5. Plume shape and locations..... | 10 |

Tables

| | |
|---|----|
| Table 1. Explosives constituents for munitions used during firing point tests. | 5 |
| Table 2. Data for sampled areas—decision unit areas. | 11 |
| Table 3. Data for sampled areas—sampling statistics..... | 12 |
| Table 4. Analytical data for energetics in plumes..... | 13 |
| Table 5. Summary for blow-in-place detonations. | 14 |
| Table 6. Gradient test results for HMX and RDX. | 15 |
| Table 7. Field quality assurance test results. | 15 |
| Table 8. HE munitions BIP and live-fire detonation energetics residues data. | 17 |

Preface

This report was prepared by Michael R. Walsh, Engineering Resources Branch, and Alan D. Hewitt and Charles M. Collins, Environmental Sciences Branch, Cold Regions Research and Engineering Laboratory (CRREL), U.S. Army Engineer Research and Development Center (ERDC). Manuscript review was provided by Dr. C. L. Grant and Christopher R. Williams. Funding was provided by the U.S. Army Garrison, Alaska, Soil and Water Monitoring Program (Gary Larson, coordinator).

Field work of this nature is complex and requires the involvement and cooperation of many different people and entities. The authors thank L. D. Fleshman, Range Facility Manager, U.S. Army, Alaska, for his support of this and the many tests we have conducted on his ranges over the years. We also thank SFC Jason Doty and the men of the 716th Explosive Ordnance Disposal detachment at Fort Richardson, AK, for taking time from their busy schedules to obtain the munitions required for these tests and then blowing them up. Jeff Bryant of Bering Sea Eccotech supported us as the Site Safety Officer and as our unexploded ordnance technician (UXO Tech III), helping us to avoid any encounters with UXOs. Our field crew included Jon Zufelt, Stephanie Saari, Anna Wagner, Jennifer Fadden, Rebecca Terry (U.S. Army Corps of Engineers, Jacksonville, FL), and Art Gelvin. Back at the lab, Nancy Perron and Marianne Walsh joined in the analysis of the samples. A lot had to happen right and on time to make these tests successful, and this crew made it happen. Our thanks to all of them.

This report was prepared under the general supervision of Dr. Bert Davis, Director, CRREL. The Commander and Executive Director of ERDC is COL Gary E. Johnston. The Director is Dr. James R. Houston.

Unit Conversion Factors

| Multiply | By | To Obtain |
|--------------------|----------------|-----------------|
| cubic feet | 0.02831685 | cubic meters |
| cubic inches | 1.6387064 E-05 | cubic meters |
| cubic yards | 0.7645549 | cubic meters |
| degrees Fahrenheit | $(F-32)/1.8$ | degrees Celsius |
| feet | 0.3048 | meters |
| inches | 0.0254 | meters |
| pounds (mass) | 0.45359237 | kilograms |

Nomenclature

| | |
|-----|--|
| AcN | acetonitrile |
| HMX | octahydro-1,3,5,7-tetranitro-1,3,5,7-tetrazocine |
| NG | nitroglycerine |
| RDX | hexahydro-1,3,5-trinitro-1,3,5-triazine |
| TNT | 2,4,6-trinitrotoluene |

1 Introduction

Firing ranges provide soldiers the opportunity to train using a variety of munitions. However, live-fire training with high-explosive munitions will result in the generation of energetic residues on the range. The major sources include unexploded (non-functioning) ordnance, low-order detonations with a significant fraction of the high-explosive filler remaining unconsumed, and small quantities of explosive residues from fully functioning high-order detonations. These are potential and contributing sources of unconsumed energetic materials that can contaminate the soil and the groundwater and, in sufficient quantities, can threaten human health and the environment and result in the loss of use of the facility.

Hundreds of thousands of rounds are fired into military impact ranges each year (Foster 1998). The majority of these rounds detonate cleanly and efficiently and deposit very little explosive residue (Hewitt et al. 2003; Taylor et al. 2004; Walsh et al. 2005a, 2006b; Walsh 2007). However, a small percentage of the ordnance, estimated to be less than 2%, does not function properly, resulting in unexploded ordnance (Dauphin and Doyle 2000). Unexploded ordnance (UXO) is a serious range safety hazard. Along with low-order detonations, where only part of the explosive filler is consumed, they are the most significant point source for high-explosive (HE) contamination on an impact range. Range closures due to contamination have driven the military toward more thorough range maintenance, including clearance of UXO. Studies show that the disposal of these items in situ (blow-in-place [BIP]) is not as efficient as the live-fire detonation of munitions and may result in the deposition of significant quantities of explosives on the range (Hewitt et al. 2003; Walsh et al. 2005a, 2006a).

The data set for BIP residues is limited, due in part to the difficulty of quantifying residues from the detonation of a munition. The methods developed by Jenkins et al. (2000) and Walsh et al. (2005c, 2007) on snow-covered ice for both live-fire and BIP detonations allow the isolation of detonation residues from previous range activities, the effective demarcation of the residue plume, and the efficient collection of residues for analysis. This report addresses the major remaining data gap in range use of common U.S. Army high-explosive munitions, the BIP disposal of unexploded, fuzed 60-mm and 120-mm mortar cartridges.

In 2008, we conducted a series of BIP tests on fuzed 60-mm and 120-mm mortar cartridges. The study objective was to determine the explosives residues quantities on a per-round basis and to compare these results with those of previous results obtained under similar conditions.

2 Field Tests

Field site

The tests were conducted on the Eagle River Impact Area, Fort Richardson, AK. Eagle River Flats (ERF) is an estuarine salt marsh along the upper Cook Inlet that periodically floods and freezes over the winter, building up layers of ice over the impact area (Figure 1). With a fresh layer of snow on the ice, this area is ideal in the winter for conducting explosive residues tests because the detonations are segregated from past activity on the Flats and residue plumes are easily discerned on the snow surface. At the time of these tests in February 2008, temperatures ranged from -4°C to near freezing. Winds were variable from the north at under 3 m/sec with partially overcast skies. Snow depth ranged from 10 to 30 cm, and ice thickness varied to up to 65-cm deep. The snow surface was consolidated by prior wind and sun exposure but was not crusted over. No snow fell and no drifting occurred during the tests. Little unfrozen water lay beneath the ice.



Figure 1. Eagle River Flats impact area in winter.

The tests were conducted in a location designated as Area C on the Flats. The test area is underlain by a shallow ponded area—frozen to depth during testing—and an “upland” (mudflat) zone between the pond and the river levee. This area is easily accessible from the access road to the edge of the Flats. An ice road was cleared and plowed to the test site and parallel

roads plowed perpendicular to the prevailing winds to provide access to the detonation points (Figure 2).

Munitions

Two munitions were detonated during our tests (Table 1). The 60-mm test munitions were M888 high-explosive cartridges with an M935 point detonating (PD) fuze mounted in the nose (Figure 3a). For the 120-mm tests, the M933 HE cartridge with an M745 point detonating fuze (Figure 3b) was detonated. The donor charge for both munitions was a single block of C4. Appendix A contains complete munitions data for these tests.



Figure 2. Ice road to BIP sites from ERF access road.

Tests

Our tests were conducted in association with the 716th Explosive Ordnance Disposal (EOD) detachment, Fort Richardson, AK. Coordinating with the mission command, we located detonation points for each set of seven rounds on either side of the access roads to enable testing with the wind blowing in either direction. The 716th EOD detachment was responsible for drawing the munitions, setting the charges, and detonating the rounds.

The 120-mm tests were run first. A background surface snow sample from the test area was collected before detonation activity. Clean ice blocks were cut for the tests from a nearby freshwater lake to be used to prevent pene-

Table 1. Explosives constituents for munitions used during firing point tests.

| Munition | Component | Constituent | Weight (g) |
|-----------------|--------------------------------|------------------|------------|
| M888 | HE Filler | Comp B | 358 |
| | | RDX ^a | 215 |
| | | TNT | 140 |
| | M935 Fuze | — | 13.1 |
| | | RDX ^a | 12.7 |
| | M702 Ign. Ctg. ^b | Prop M9 | 3.37 |
| | | NG | 1.35 |
| M933 | HE Filler | Comp B | 2,990 |
| | | RDX ^a | 1,794 |
| | | TNT | 1,166 |
| | M745 Fuze | — | 10.2 |
| | | RDX ^a | 7.9 |
| | | HMX | 0.13 |
| M112 (Donor) | C4 | Prop M44 | 68 |
| | | NG | 30 |
| | | — | 567 |
| | | RDX ^a | 516 |

^aRDX may contain up to 9% HMX in Composition B explosive.

^bIgnition cartridge.

tration to ground when the rounds were detonated. These blocks were 30- to 45-cm thick. Each fuze M933 HE cartridge was placed 15 m from the access road and 40-m apart on an ice block approximately 1-m long by 0.5-m wide by 0.4-m thick. A block of C4 explosive (M112) was placed adjacent to the body of the horizontal cartridge near the nose end. A blasting cap initiator and time fuze were then attached to the donor charge. When the area was clear, the rounds were set off simultaneously. One donor initiator failed to function properly and was replaced within 20 min. The area was once again cleared and the round detonated. At the time of detonation, the temperature was -3.8°C with a north wind of 0–3 m/sec. There was no precipitation and no drifting of snow.

Following clearance of the detonation points, the plumes were demarcated by walking the visible perimeter of the soot-discolored snow with a global positioning satellite (GPS) system (Trimble GPS Pathfinder Pro XR; ±1-m accuracy). The outline of the plume was recorded, as was the detonation point for each event. Triplicate 10- x 10- x 2.5-cm deep multi-increment (MI) surface snow samples were then taken within each plume, and duplicate MI samples were also taken from the 0- to 2-m annulus outside the



a. M888 60-mm HE cartridge with M112 donor charge on ice surface.



b. M933 120-mm HE cartridge on ice block.

Figure 3. Munitions used in BIP tests.

visible plume. To obtain the MI samples within the plume, parallel lanes 2-m apart were walked throughout the plume and increments systematically collected every 3 m from a randomly selected starting location at the beginning of the first lane. For outside-the-plume (OTP) samples, a similar procedure was used except there was only one lane through the middle of the annulus and samples were systematically collected from either side of the lane from a random starting point. On one plume, triplicate 20- x 20- x 2.5-cm MI surface samples were taken directly followed by 10- x 10- x 2.5-

cm “subsurface” samples from the area just sampled. These quality assurance procedures were done to determine if we adequately delineated the plume and if we sampled deep enough to collect the majority of the residues at the sampled points. For a full description of energetics sampling on snow, see Walsh et al. (2007).

The following day, the procedure was repeated for the 60-mm mortar cartridges. In this case, however, the rounds were set directly on the ice at a distance of 42-m apart. All rounds detonated simultaneously and the sampling procedure repeated. One additional test was performed on one of the detonation plumes. The plume was divided into three zones based on perceived soot density. Each of these gradient zones was then sampled in duplicate to determine the difference in energetics concentrations. This test was performed to determine the effect of “gradient bias,” or the tendency to sample only where the greatest evidence of contamination exists (Walsh et al. 2005c).

Sample processing and analysis

The multi-increment snow samples were transferred to a lab set up nearby on post for processing. The samples were melted, filtered (Figure 4), and the aqueous fraction concentrated using solid-phase extraction (Walsh and Ranney 1998; Walsh et al. 2007). When processing was completed, the solid-phase extraction (SPE) cartridges and the soot fraction filters were shipped to the analytical chemistry laboratory at CRREL’s main office in Hanover, NH, for final processing and analysis.

The filters containing the soot fractions were extracted using acetonitrile. Each sample was shaken with the solvent for 18 h. The acetonitrile extracts from the solid phase extraction of the melted snow and of the solid residue on the filters were analyzed by high-performance liquid chromatography (HPLC). Analyte concentrations were determined following the general procedures of SW 846 Method 8330 to determine nitroaromatics and nitramines by HPLC (USEPA 1994). The HPLC method has an analytical error that is very small, about 2% relative standard deviation (RSD) for replicate injections.

Before HPLC analysis, 1 mL of each acetonitrile extract was mixed with 3 mL of reagent-grade water. Determinations were made on a modular system from Thermo Electron Corporation (Waltham, MA) composed of a

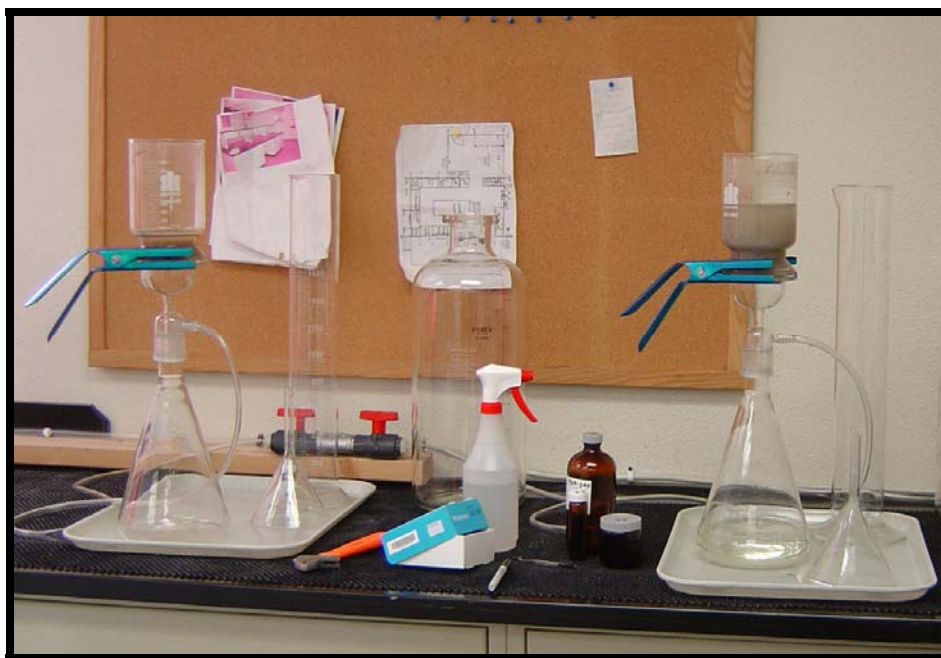


Figure 4. Sample filtration setup.

Finnigan SpectraSYSTEM Model P4000 pump, a Finnigan SpectraSYSTEM UV2000 dual wavelength ultraviolet/visible absorbance detector set at 210 and 254 nm (cell path 1 cm), and a Finnigan SpectraSYSTEM AS300 autosampler. Samples were introduced with a 100- μ L sample loop. Separations were achieved on a 15-cm x 3.9-mm (4- μ m) NovaPak C8 column (Waters Chromatography Division, Milford, MA) at 28°C and eluted with 1.4 mL/min of 15:85 isopropanol/water (v/v).

Calibration standards were prepared from analytical reference materials obtained from Restek Corporation (Bellefonte, PA). The analytical reference materials were 8095 Calibration Mix A (1 mg/mL) and a single-component solution of NG (1 mg/mL). A spike solution at 1,000 μ g/L was prepared from 8095A Calibration Mix and the single-component solution of NG (10,000 μ g/L). Spiked water samples at 2 μ g/L were prepared by mixing 0.10 mL of the spike solution to 500 mL of water in a volumetric flask. Following SPE, the extract target concentration was 200 μ g/L for each analyte.

To calculate the mass of unreacted energetics deposited on the snow, we multiplied the average concentration of each plume (mass/unit area basis) by the measured area of the plume (Jenkins et al. 2002; Hewitt et al. 2003). We used a detection limit of 0.02 mg/L for HMX, RDX, and TNT

and 0.05 mg/L for NG. Values below these limits are labeled as ND in the data.

Quality assurance procedures

Quality assurance (QA) procedures were conducted both in the field and in the lab. Field QA, noted previously, included replicate sampling within the residue plumes, sampling outside the demarcated plumes, using multiple sampling designs, and sampling below previously sampled points.

We also conducted QA procedures in the processing lab. Blank samples consisting of filtered water (Barnstead E-Pure filtration system; 80 M Ω minimum) were periodically run through a filter assembly and pre-concentrated using SPE for later analysis at the lab. This procedure is designed to determine if cross-contamination from the sample filtering apparatus or glassware is occurring. SPE laboratory control samples (LCSs) were run to determine cartridge filter performance. These processes are described in greater detail in Walsh et al. (2005b).

3 Results

Baseline samples

The background sample collected from the firing points before the test was blank, indicating clean test areas. Results are given in Appendix D.

BIP detonation plumes

A total of 88 multi-increment samples composed of 7,811 increments were taken to characterize the BIP detonation plumes. The demarcated plume sizes ranged from approximately 400 m² for a 60-mm detonation to 2,000 m² for a 120-mm detonation, averaging 1,500 m² for the 120s and 500 m² for the 60s (Table 2). OTP areas varied from approximately 200 m² to 580 m², averaging about 30% of the plume area for the 120s and 46% of the plume area for the 60s. Areas were calculated with geographic information system software using the GPS field data points. In most cases, the 10-cm scoop was used to sample the plumes, OTP areas, and subsurface. On average, 0.08% of the plume areas and 0.2% of the OTP areas were sampled for the 120s, and 0.19% of the plume areas and 0.4% of the OTP areas were sampled for the 60s (Table 3). A map of the detonation plumes derived from the GPS data is given in Figure 5.

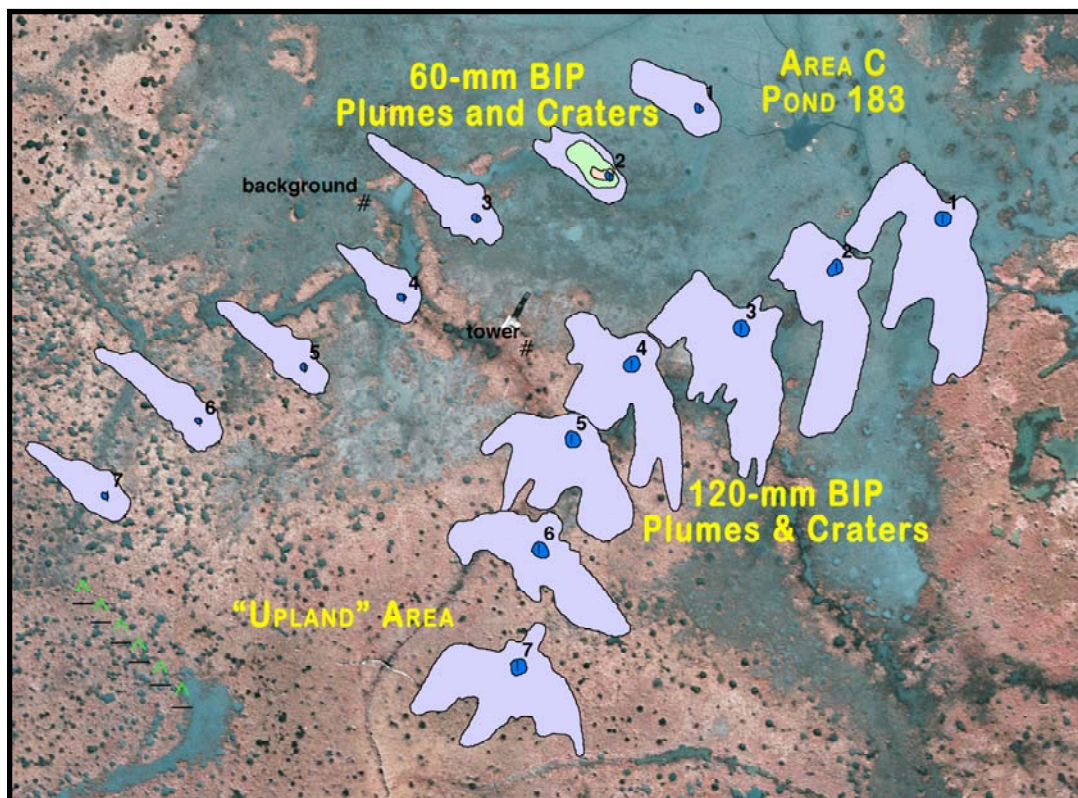


Figure 5. Plume shape and locations.

Table 2. Data for sampled areas—decision unit areas.

| Detonation No. | Round Type | Plume | | Plume+OTP | | OTP Area (m ²) |
|-----------------|------------|------------|------------------------|------------|------------------------|----------------------------|
| | | Length (m) | Area (m ²) | Length (m) | Area (m ²) | |
| 1 | 120 mm | 280 | 2,000 | 290 | 2,600 | 580 |
| 2 | 120 mm | 210 | 1,500 | 220 | 1,900 | 420 |
| 3 | 120 mm | 270 | 1,800 | 240 | 2,300 | 520 |
| 4 | 120 mm | 250 | 1,500 | 240 | 2,000 | 490 |
| 5 | 120 mm | 220 | 1,400 | 210 | 1,800 | 440 |
| 6 | 120 mm | 200 | 1,200 | 210 | 1,700 | 410 |
| 7 | 120 mm | 230 | 1,400 | 240 | 1,900 | 470 |
| Averages | | 240 | 1,500 | 240 | 2,000 | 480 |
| 1 | 60 mm | 94 | 480 | 110 | 680 | 200 |
| 2 | 60 mm | 96 | 470 | 110 | 680 | 200 |
| 3 | 60 mm | 140 | 620 | 150 | 910 | 290 |
| 4 | 60 mm | 94 | 400 | 100 | 590 | 200 |
| 5 | 60 mm | 120 | 500 | 130 | 740 | 240 |
| 6 | 60 mm | 130 | 600 | 140 | 870 | 270 |
| 7 | 60 mm | 100 | 430 | 110 | 650 | 220 |
| Averages | | 110 | 500 | 120 | 730 | 230 |
| 7-medium | 60 mm | 54 | 150 | — | — | — |
| 7-dark | 60 mm | 23 | 27 | — | — | — |

Table 3. Data for sampled areas—sampling statistics.

| Munition | Decision Unit | Sampling Tool Size (cm) | Average No. of Increments | Average Area Sampled (m ²) | Average Area Sampled (%) |
|----------|---------------|-------------------------|---------------------------|--|--------------------------|
| 120 mm | Plume 1 | 10 x 10 x 2.5 | 137 | 1.37 | 0.07% |
| | OTP 1 | 10 x 10 x 2.5 | 100 | 1.00 | 0.17% |
| | Plume 2 | 10 x 10 x 2.5 | 142 | 1.42 | 0.07% |
| | OTP 2 | 10 x 10 x 2.5 | 100 | 1.00 | 0.24% |
| | Plume 3 | 10 x 10 x 2.5 | 97 | 0.97 | 0.05% |
| | OTP 3 | 10 x 10 x 2.5 | 100 | 1.00 | 0.19% |
| | Plume 4 | 10 x 10 x 2.5 | 148 | 1.48 | 0.10% |
| | OTP 4 | 10 x 10 x 2.5 | 100 | 1.00 | 0.20% |
| | Plume 5 | 10 x 10 x 2.5 | 102 | 1.02 | 0.07% |
| | OTP 5 | 10 x 10 x 2.5 | 101 | 1.01 | 0.23% |
| | Plume 6 | 10 x 10 x 2.5 | 105 | 1.05 | 0.08% |
| | OTP 6 | 10 x 10 x 2.5 | 100 | 1.00 | 0.24% |
| | Plume 7 | 10 x 10 x 2.5 | 123 | 1.23 | 0.09% |
| | | 20 x 20 x 2.5 | 30 | 1.20 | 0.08% |
| | Subsurface 7 | 10 x 10 x 2.5 | 30 | 0.30 | 0.02% |
| | OTP 7 | 10 x 10 x 2.5 | 63 | 0.63 | 0.14% |
| Averages | Plume | | 122 | 1.22 | 0.08% |
| | OTP | | 95 | 0.95 | 0.20% |
| 60 mm | Plume 1 | 10 x 10 x 2.5 | 80 | 0.80 | 0.17% |
| | OTP 1 | 10 x 10 x 2.5 | 100 | 1.00 | 0.50% |
| | Plume 2 | 10 x 10 x 2.5 | 84 | 0.84 | 0.18% |
| | -Light | 10 x 10 x 2.5 | 53 | 0.53 | 0.20% |
| | -Medium | 10 x 10 x 2.5 | 87 | 0.87 | 0.49% |
| | -Dark | 10 x 10 x 2.5 | 41 | 0.41 | 1.52% |
| | OTP 2 | 10 x 10 x 2.5 | 84 | 0.84 | 0.41% |
| | Plume 3 | 10 x 10 x 2.5 | 100 | 1.00 | 0.16% |
| | OTP 3 | 10 x 10 x 2.5 | 95 | 0.95 | 0.33% |
| | Plume 4 | 10 x 10 x 2.5 | 96 | 0.96 | 0.24% |
| | OTP 4 | 10 x 10 x 2.5 | 87 | 0.87 | 0.45% |
| | Plume 5 | 10 x 10 x 2.5 | 107 | 1.07 | 0.21% |
| | OTP 5 | 10 x 10 x 2.5 | 89 | 0.89 | 0.37% |
| | Plume 6 | 10 x 10 x 2.5 | 92 | 0.92 | 0.15% |
| | OTP 6 | 10 x 10 x 2.5 | 83 | 0.83 | 0.31% |
| | Plume 7 | 10 x 10 x 2.5 | 100 | 1.00 | 0.23% |
| | | 20 x 20 x 2.5 | 26 | 1.04 | 0.24% |
| | Subsurface 7 | 10 x 10 x 2.5 | 26 | 0.26 | 0.06% |
| | OTP 7 | 10 x 10 x 2.5 | 89 | 0.89 | 0.41% |
| Averages | Plume | | 94 | 0.94 | 0.19% |
| | OTP | | 90 | 0.90 | 0.40% |

Analytical data averaged for the replicates are given in Table 4. Two significant digits are used for the data in this table and throughout this report. The samples were analyzed for a series of energetic compounds: RDX, HMX, TNT, and NG. The NG is contained in the ignition cartridge in the tail of the mortar cartridge. In combination with the nitrocellulose matrix in which it is embedded, it is less sensitive than the donor and filler charges (low explosive as opposed to high explosive). Its normal means of reaction is deflagration (rapid burning) rather than detonation. This, in combination with its distance from the donor charge, results in less material consumed during the BIP operation. The HMX is a byproduct in the manufacturing process for RDX and is found in quantities of 8% to 12% in the Type B RDX in the Comp B filler (U.S. Army 2004). It is also found in very small quantities in the fuze of the 120-mm cartridge. More complete data sets can be found in Appendixes B and C.

Table 4. Analytical data for energetics in plumes.

| Munition | Detonation No. | Total Mass (mg) | | | For RDX | | For HMX | |
|----------|---------------------|-----------------|------------|--------------|-----------|------------|------------|------------|
| | | HMX | RDX | NG | Range | RSD | Range | RSD |
| 120 mm | 1 | <0.02 | 4.6 | 3,900 | 1.8 | 20% | — | 0% |
| | 2 | 4.4 | 13 | 4,400 | 2.5 | 10% | 2.4 | 28% |
| | 3 | 8.0 | 19 | 3,300 | 8.9 | 23% | 4.0 | 25% |
| | 4 | 4.3 | 46 | 3,900 | 31 | 34% | 0.5 | 6% |
| | 5 ^a | <0.02 | 6.3 | 4,500 | 2.1 | 17% | — | 0% |
| | 6 | 4.4 | 37 | 7,600 | 9.9 | 14% | 2 | 18% |
| | 7 (100) | <0.02 | 17 | 3,500 | 3.7 | 13% | — | 0% |
| | 7 (20) ^b | <0.02 | 35 | 8,100 | — | — | — | 0% |
| | Averages | 3.0 | 22 | 4,800 | 11 | 22% | 1.2 | 11% |
| 60 mm | 1 | 4.2 | 32 | 200 | 8.8 | 16% | 1.3 | 18% |
| | 2 | 9.6 | 49 | 240 | 6.7 | 7.2% | 3.7 | 19% |
| | 3 | 50 | 400 | 240 | 99 | 13% | 21 | 21% |
| | 4 | 27 | 270 | 170 | 3.5 | 0.73% | 7.8 | 17% |
| | 5 | 36 | 220 | 290 | 150 | 35% | 17 | 24% |
| | 6 | 4.4 | 30 | 250 | 9.8 | 16% | 2.2 | 28% |
| | 7 (100) | 20 | 220 | 230 | 27 | 6.4% | 2.7 | 7.0% |
| | 7 (20) | 21 | 260 | 200 | 190 | 38% | 5.5 | 13% |
| | Averages | 22 | 180 | 230 | 56 | 16% | 8.2 | 19% |

Notes:

Range is the difference between the highest and lowest values for the analyte.

^aRDX value includes the OTP mass (0.35 mg).

^bTwo of three values for RDX are below quantitation range; range and RSD not calculated.

Using the results presented in Table 4, we can derive the average efficiency of the BIP operations. For the 120s, $7.1 \times 10^{-4} \%$ of the cartridge and donor charge HE load remained on average after detonation. If only HMX and RDX are considered, $1.1 \times 10^{-3} \%$ remained on average after detonation. The residues rate ranged from $1.3 \times 10^{-4} \%$ for BIP No. 1 to $1.4 \times 10^{-3} \%$ for BIP No. 4. NG residues averaged 16%. For the 60s, $2.3 \times 10^{-2} \%$ of the cartridge and donor charge HE load remained on average after detonation. For the RDX and HMX alone, $2.7 \times 10^{-2} \%$ remained on average. The residues rates ranged from $3.9 \times 10^{-3} \%$ for BIP No. 6 to $5.1 \times 10^{-2} \%$ for BIP No. 3. NG residues averaged 17%, quite close to the value obtained for the 120s. The averaged HE residues deposition mass was 25 mg/round for the 120s and 200 mg/round for the 60s. Very little TNT was detected in the 60-mm residues and none was detected in the 120-mm residues. Table 5 summarizes these data and Table 8 (Discussion) compares them to other detonation tests.

Table 5. Summary for blow-in-place detonations.

| Munition | No. of Rounds | Plume Area (m ²) | RDX (mg) | HMX (mg) | TNT (mg) | Total (mg) | Total (%) ^a |
|---------------------|---------------|------------------------------|----------|----------|----------|------------|------------------------|
| 60-mm mortar (M374) | 7 | 500 | 180 | 22 | ND | 200 | 2.3×10^{-2} |
| 120-mm mortar (M1) | 7 | 1,600 | 22 | 3.0 | ND | 25 | 7.7×10^{-4} |

^aExplosives load includes the contribution of the C4 donor charge.

ND, not detected (below detection limits of instrumentation).

The gradient test yielded the expected results. In the small, darkest zone, 42% of the residues mass was recovered from just 6% of the area. In the intermediate zone, 44% of the mass was recovered from 32% of the area. In the lightest zone, only 15% of the mass was recovered from an area encompassing 63% of the plume. Looking at the ratios of recovered energetics to percent of area sampled within the plume, the dark area contained seven times more residues per unit area than the plume as a whole. Table 6 summarizes the data from this test.

The field QA procedure results indicate that the majority of detectable energetic residues were within the sampled depth of the demarcated plume area and meet data quality objectives. Table 7 contains the results for both series of tests. The amount of HE residues found in the sampled area outside the demarcated plume (OTP) compared to inside the plume is expressed as a percentage of the plume mass under OTP:Plume. For the OTP

Table 6. Gradient test results for HMX and RDX.

| Zone | Total Mass (mg) | | | | Area (m ²) | % of Area | % of Mass | Ratio Mass/Area |
|--------------------|-----------------|-----|-----|------|------------------------|-----------|-----------|-----------------|
| | HMX | | RDX | | | | | |
| Plume ^a | 9.6 | — | 49 | — | 470 | 100% | 100% | 1.0 |
| Light | 0.0 | 0% | 8.8 | 16% | 300 | 63% | 15% | 0.23 |
| Medium | 2.7 | 44% | 24 | 44% | 150 | 32% | 44% | 1.4 |
| Dark | 3.4 | 56% | 21 | 40% | 27 | 6% | 42% | 7.2 |
| Total | 6.1 | 64% | 54 | 110% | 470 | — | — | — |

^aAveraged results for total plume from Table 4, 60-mm Plume 2.

sampling, the target value is <5% of the plume mass. Only one of the 14 OTP samples exceeded 5%, 5.5% for plume 5. The OTP residue mass for plume 5 was thus added to the plume mass in Table 4. The target value for the subsurface mass to plume mass (SS:Plume) is <1% of the plume mass. Neither of the subsurface samples exceeded the target value. Values for the RSDs of the triplicate plume samples, found in Table 4, were also very good. The target value is <30% RSD. Only three of the 32 sets of data for the HE residues exceeded 30%, and all were less than 40%. Average RSD for the 32 sets of data is 17% (0% to 38%).

Table 7. Field quality assurance test results.

| Plume No. | 60-mm BIPs | | | | 120-mm BIPs | | | |
|-----------|------------|----------|-----------|----------|-------------|----------|-----------|----------|
| | RDX | | HMX | | RDX | | HMX | |
| | OTP:Plume | SS:Plume | OTP:Plume | SS:Plume | OTP:Plume | SS:Plume | OTP:Plume | SS:Plume |
| 1 | 0.0% | — | 0.00% | — | 0.0% | — | 0.00% | — |
| 2 | 0.0% | — | 0.00% | — | 0.0% | — | 0.00% | — |
| 3 | 0.2% | — | 0.00% | — | 0.0% | — | 0.00% | — |
| 4 | 0.6% | — | 0.00% | — | 1.7% | — | 0.00% | — |
| 5 | 0.8% | — | 0.00% | — | 5.5% | — | 0.00% | — |
| 6 | 0.0% | — | 0.00% | — | 0.9% | — | 0.00% | — |
| 7 (100) | 1.6% | 0.59% | 3.20% | 0.09% | 0.0% | 0.0% | 0.00% | 0.00% |
| 7 (20) | 1.3% | 0.50% | 3.06% | 0.11% | 0.0% | 0.0% | 0.00% | 0.00% |
| Averages | 0.42% | 0.54% | 0.45% | 0.10% | 1.2% | 0.00% | 0.00% | 0.00% |

Finally, the QA results from the lab are also very good. All filtration blanks were clean with the exception of one that had trace amounts of NG on the filter. The source of the NG could not be determined but did not adversely affect other data. The SPE glassware test blanks had no detectable energetics, and the LCS runs returned values from 90% to 105% on average (0.18–0.21 mg/L). Data can be found in Appendix D.

4 Discussion

Working with energetics residues is a difficult proposition. This is especially true with an unconfined charge, such as the block of C4 used as a donor charge (Brochu et al. 2004). Residues are particulate in form and quite heterogeneously distributed. The quantity of residues also tend to be quite low, especially for the larger munitions that are more efficient when detonated. These low quantities result in many analyte concentrations at or near the analytical detection limits. Another confounding factor we came up against was the high quantities of NG in the samples. Because the rounds had not been fired, the ignition cartridges in the tails of the mortars were not expended, and the full load of propellant was present in these cartridges. Because the propellant is designed to burn rather than detonate, the BIP process is inefficient in the disposal of the material. Relatively large quantities of NG in the field samples made analysis of the samples difficult.

The configuration of the donor charge on the test munitions was according to standard EOD practice. The use of a complete block of C4, containing 516 g of RDX, to initiate a 60-mm mortar cartridge, containing less than 370 g of high explosives, may seem excessive, but it is standard practice. Part of the reason why the BIP of the 60-mm cartridge was so much “dirtier” than the BIP of the 120-mm cartridge was the presence of such a large amount of unconfined explosive during the operation. Detonation tests of blocks of C4 alone indicate relatively high residues rates, $2.6 \times 10^{-3}\%$ ($n = 11$), compared to residue rates from fully functioning rounds ($< 2 \times 10^{-4}\%$) and BIP operations with the larger projectiles ($< 8 \times 10^{-4}\%$) (Walsh 2007). With the 120s, the resulting detonation of the cartridge assists in the consumption of the donor charge, making the overall process much more efficient. Work needs to be done to refine the protocol for configuring a BIP operation.

Overall, the data fit in well with other BIP and live-fire data. Table 8 summarizes these data for tests conducted on snow by CRREL since early 2002. The trend has been that BIPs are not as clean as live-fire detonations, larger rounds consume the HE more efficiently than the smaller rounds, and mortar cartridges are less efficient than howitzer rounds.

With the exception of the live-fire 60-mm HE cartridges, this is demonstrated by the results shown in the table.

Table 8. HE munitions BIP and live-fire detonation energetics residues data.

| Weapon System | BIP ^a (TNT, HMX, RDX) | Live-Fire Detonation (TNT, HMX, RDX) |
|-----------------|-------------------------------------|---|
| Mortars | | |
| 60 mm (Comp B) | 200 mg / $2.3 \times 10^{-2}\%$ | 0.076 mg / $2.0 \times 10^{-5}\%$ |
| 81 mm (Comp B) | 150 mg / $1.0 \times 10^{-2}\%$ | 9.4 mg / $1.0 \times 10^{-3}\%$ |
| 120 mm (Comp B) | 25 mg / $7.7 \times 10^{-4}\%$ | 21 mg / $4.8 \times 10^{-4}\%$ |
| Howitzers | | |
| 105 mm (Comp B) | 50 mg / $1.9 \times 10^{-3}\%$ | 0.27 mg / $1.3 \times 10^{-5}\%$ |
| 155 mm (Comp B) | 17 mg / $2.2 \times 10^{-4}\%$ | 0.31 mg / $4.4 \times 10^{-6}\%$ |
| 155 mm (TNT) | 15 mg / $2.1 \times 10^{-4}\%$ | 0.00 mg / $0.0 \times 10^{-6}\%$ |

^aIncludes donor charge mass.

5 Conclusions

Two tests were conducted on the ice-covered Eagle River Flats impact area of Fort, Richardson, AK, to determine the quantity and percent levels of energetics residues remaining after standard blow-in-place detonation of fused 60-mm and 120-mm mortar cartridges using a single block of C4 as a donor charge. Seven rounds of each high-explosive munition were detonated and the resultant plumes sampled in triplicate. Quality assurance procedures were conducted in the field to ensure the detonation plumes were correctly demarcated and the sampling was valid. Multi-increment sampling on the snow surface was used to characterize the decision units. The averaged result for the 60-mm test was 200 mg of RDX and HMX residues per round, giving a residues rate of 0.022% of the original analyte load (fuze plus filler plus donor charge). Residues found in a 2-m band outside the demarcated plume averaged 0.43% of the plume load, and subsurface sampling below previously sampled points yielded less than 0.32% of the surface sample mass. The averaged result for the 120-mm test was 27 mg of RDX and HMX residues per round, giving a residues rate of 0.00077% of the original analyte load (fuze plus filler plus donor charge). Residues found in a 2-m band outside the demarcated plume averaged 0.58% of the plume load, and subsurface sampling below previously sampled points contained undetectable amounts of high explosives. The results of these tests fit well with deposition data for other munitions.

References

- Brochu, S., S. Thiboutot, J. Lewis, G. Ampleman, and P. Brousseau. 2004. *Estimation of the quantity of explosive residues resulting from the detonation of unconfined explosives charges*, Chapter 7. In *Distribution and fate of energetics on DoD test and training ranges: Interim Report 4*. ERDC TR-04-4. Vicksburg, MS: U.S. Army Engineer Research and Development Center.
- Dauphin, L., and C. Doyle. 2000. *Study of ammunition dud and low order detonation rates*. U.S. Army Defense Ammunition Center-Technical Center for Explosives Safety. Technical Report. Aberdeen Proving Ground, MD: U.S. Army Environmental Center.
- Foster, J. 1998. Report of the Defense Science Board Task Force on Unexploded Ordnance (UXO) Clearance, Active Range UXO Clearance, and Explosive Ordnance Disposal Programs. Washington, DC: Department of Defense.
- Hewitt, A. D., T. F. Jenkins, T. A. Ranney, J. A. Stark, M. E. Walsh, S. Taylor, M. R. Walsh, D. J. Lambert, N. M. Perron, N. H. Collins, and R. Kern. 2003. *Estimates for explosives residues from the detonation of army munitions*. ERDC/CRREL Technical Report 03-16. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- Jenkins, T. J., T. A. Ranney, P. H. Miyares, N. H. Collins, and A. D. Hewitt. 2000. *Use of surface snow sampling to estimate the quantity of explosive residues resulting from land mine detonations*. ERDC/CRREL Technical Report TR-00-12. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- Jenkins, T. F., M. E. Walsh, P. H. Miyares, A. D. Hewitt, N. H. Collins, and T. A. Ranney. 2002. Use of snow-covered ranges to estimate explosives residues from high-order detonations of army munitions. *Thermochimica Acta*, 384:173-185.
- Taylor S., J. H. Lever, B. Bostick, M. R. Walsh, M. E. Walsh, and B. Packer. 2004. *Underground UXO: are they a significant source of explosives in soil compared to low- and high-order detonations?* ERDC/CRREL Technical Report TR-04-23. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- U.S. Army. 1994. *Military explosives*. Department of the Army TM 9-1300-214. Washington, DC: Headquarters, Department of the Army.
- USEPA. 1994. *Nitroaromatics and nitramines by high performance liquid chromatography (HPLC)*. Method 8330A. Washington, DC: U.S. Environmental Protection Agency.
- Walsh, M. E., and T. A. Ranney. 1998. *Determination of nitroaromatic, nitramine, and nitrate ester explosives in water using solid-phase extraction and GC-ECD*. Special Report 98-2. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.

- Walsh M. R., S. Taylor, M. E. Walsh, S. R. Bigl, K. Bjella, T. A. Douglas, A. B. Gelvin, D. J. Lambert, N. M. Perron, and S. P. Saari. 2005a. *Residues from live fire detonations of 155-mm howitzer rounds*. ERDC/CRREL Technical Report TR-05-14. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- Walsh M. R., M. E. Walsh, C. M. Collins, S. P. Saari, J. E. Zufelt, A. B. Gelvin, and J. W. Hug. 2005b. *Energetic residues from live-fire detonations of 120-mm mortar rounds*. ERDC/CRREL Technical Report TR-05-15. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- Walsh M. R., M. E. Walsh, C. A. Ramsey, and T. F. Jenkins. 2005c. *An examination of protocols for the collection of munitions-derived explosives residues on snow-covered ice*. ERDC/CRREL Technical Report TR-05-08. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- Walsh, M. R., M. E. Walsh, G. Ampleman, S. Thiboutot, and D. D. Walker. 2006a. *Comparison of explosive residues from blow-in-place detonation of 155-mm high-explosive projectiles*. ERDC/CRREL Technical Report TR-06-13. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- Walsh, M. R., M. E. Walsh, C. A. Ramsey, R. J. Rachow, J. E. Zufelt, C. M. Collins, A. B. Gelvin, N. M. Perron, and S. P. Saari. 2006b. *Energetic residue deposition from 60-mm and 81-mm mortars*. ERDC/CRREL Technical Report TR-06-10. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- Walsh, M. R. 2007. *Explosives residues resulting from the detonation of common military munitions: 2002–2007*. ERDC/CRREL Technical Report TR-07-02. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.
- Walsh, M. R., M. E. Walsh, and C. A. Ramsey. 2007. *Measuring energetics residues on snow*. ERDC/CRREL Technical Report TR-07-019. Hanover, NH: U.S. Army Cold Regions Research and Engineering Laboratory.

Appendix A: Munitions Data

Table A1 contains information relevant to the munitions used during the tests covered in this report. Table A2 contains data on the explosive load of the test components. Propellant charges are given in Table 1. The amount of propellant used per round can and did vary throughout the tests.

Table A1. Munitions data.

| NSN | DODIC | Nomenclature | Lot No. | Drawn for Tests |
|---------------|-------|--|---------------|-----------------|
| 1310011493185 | B643 | Cartridge, 60 MM HE, M888, W/Fuze, PD, M935 | MA-99A057-001 | 8 |
| 1315013431941 | C623 | Cartridge, 120 MM HE, M933, W/Fuze, PD, M745 | MM-97K025-002 | 8 |
| 1375007247040 | M023 | Charge, Demolition, M112 | — | 20 |

Note: Drawn from Fort Richardson Ammo Supply Point, 11 February 2008.

Table A2. Energetics loads before detonation.

| Munition | Energetics Quantities (g) | | | |
|------------------------------|---------------------------|-------|-----|------|
| | TNT | RDX | HMX | NG |
| Cartridge, 60 mm, M888 | 140 | 215 | 0 | 0 |
| Fuze, Point detonating, M935 | 0 | 15 | 0 | 0 |
| Cartridge, Ignition, M702 | 0 | 0 | 0 | 1.35 |
| Cartridge, 120 mm, M933 | 1,166 | 1,793 | 0 | 0 |
| Fuze, Point detonating, M745 | 0 | 43 | 0 | 0 |
| Cartridge, Ignition, M981 | 0 | 0 | 0 | 30 |
| Charge, Demolition, M112 | 0 | 516 | 0 | 0 |

Note: HMX may compose up to 9% of the mass of RDX.

Appendix B: 120-mm Data

Table B1 contains sampling data, analytical data, and final results for the 120-mm BIP test. Detection limits are 0.02 mg/L for RDX, HMX, and TNT and 0.05 mg/L for NG.

Table B1. 120-mm Mortar BIP test data.

| Sample ID | Plume No. and Rep | Type | Snow Melt Analyte Mass (µg) | | | Filters Analyte Mass (µg) | | | No. of Increment | Area (m ²) Sampled | DU Area (m ²) | Total Mass (mg) | | |
|----------------|-------------------|-----------|-----------------------------|-----|-------|---------------------------|-----|-------|------------------|--------------------------------|---------------------------|-----------------|------|-------|
| | | | HMX | RDX | NG | HMX | RDX | NG | | | | HMX | RDX | NG |
| FRA-001 | 1-1 | OTP 0–2 m | ND | ND | 7.5 | ND | ND | ND | 100 | 1.00 | 575 | 0.00 | 0.00 | 4.3 |
| FRA-002 | 1-2 | OTP 0–2 m | ND | ND | 6.0 | ND | ND | ND | 100 | 1.00 | 575 | 0.00 | 0.00 | 3.5 |
| FRA-003 | 1-1 | Plume-1 | ND | 4.3 | 3,800 | BQL | BQL | 606 | 162 | 1.62 | 2,000 | 0.0 | 5.4 | 5,439 |
| FRA-004 | 1-2 | Plume-1 | ND | 3.1 | 2,319 | BQL | BQL | 218 | 125 | 1.25 | 2,000 | 0.0 | 4.9 | 4,058 |
| FRA-005 | 1-3 | Plume-1 | ND | 2.2 | 890 | BQL | BQL | 531 | 125 | 1.25 | 2,000 | 0.0 | 3.6 | 2,274 |
| Plume Averages | | | — | 3.2 | 2,336 | — | — | 452 | — | — | — | 0.0 | 4.6 | 3,923 |
| FRA-006 | 2-1 | OTP 0–2 m | ND | ND | 11.94 | ND | ND | 5.8 | 100 | 1.00 | 423 | 0.00 | 0.00 | 7.5 |
| FRA-007 | 2-2 | OTP 0–2 m | ND | ND | 15.07 | ND | BQL | 5.8 | 100 | 1.00 | 423 | 0.00 | 0.00 | 8.8 |
| FRA-008 | 2-1 | Plume-2 | ND | 8.0 | 2,475 | 5.8 | 4.9 | 1,936 | 150 | 1.50 | 1,500 | 5.8 | 12.9 | 4,411 |
| FRA-009 | 2-2 | Plume-2 | ND | 8.0 | 3,659 | 3.8 | 3.6 | 1,710 | 143 | 1.43 | 1,500 | 4.0 | 12.1 | 5,632 |
| FRA-010 | 2-3 | Plume-2 | ND | 9.0 | 2,481 | 3 | 4.0 | 324 | 133 | 1.33 | 1,500 | 3.4 | 14.6 | 3,164 |
| Plume Averages | | | — | 8.3 | 2,872 | 4.2 | 4.2 | 1,323 | — | — | — | 4.4 | 13.2 | 4,403 |
| FRA-011 | 3-1 | OTP 0–2 m | ND | — | 10 | ND | ND | 6.7 | 100 | 1.00 | 519 | 0.00 | 0.00 | 8.9 |
| FRA-012 | 3-2 | OTP 0–2 m | ND | — | 7.9 | BQL | ND | 4.9 | 100 | 1.00 | 519 | 0.00 | 0.00 | 6.7 |
| FRA-013 | 3-1 | Plume-3 | ND | 6.0 | 1,638 | 4.6 | 2 | ND | 97 | 0.97 | 1,770 | 8.4 | 14.5 | 2,989 |
| FRA-014 | 3-2 | Plume-3 | ND | 9.0 | 1,358 | 5.4 | 3.8 | 519 | 97 | 0.97 | 1,770 | 9.9 | 23.5 | 3,426 |
| FRA-015 | 3-3 | Plume-3 | ND | 7.7 | 1,566 | 3.2 | 3.2 | 321 | 97 | 0.97 | 1,770 | 5.9 | 19.9 | 3,444 |
| Plume Averages | | | — | 7.6 | 1,521 | 4.4 | 3.0 | 420 | — | — | — | 8.0 | 19.3 | 3,286 |

Table B1 (cont'd). 120-mm Mortar BIP test data.

| Sample ID | Plume No. and Rep | Type | Snow Melt Analyte Mass (µg) | | | Filters Analyte Mass (µg) | | | No. of Increment | Area (m ²) Sampled | DU Area (m ²) | Total Mass (mg) | | |
|----------------|-------------------|-----------|-----------------------------|-------------|--------------|---------------------------|------------|--------------|------------------|--------------------------------|---------------------------|-----------------|-------------|--------------|
| | | | HMX | RDX | NG | HMX | RDX | NG | | | | HMX | RDX | NG |
| FRA-016 | 4-1 | OTP 0–2 m | ND | 2.3 | 11 | BQL | BQL | 3.2 | 100 | 1.00 | 490 | 0.00 | 1.1 | 6.9 |
| FRA-017 | 4-2 | OTP 0–2 m | ND | 0.90 | 12 | ND | ND | 5.6 | 100 | 1.00 | 490 | 0.00 | 0.44 | 8.8 |
| FRA-021 | 4-1 | Plume-4 | 1.5 | 35 | 2,836 | 3 | 8.6 | 78 | 148 | 1.48 | 1,510 | 4.6 | 44.4 | 2,972 |
| FRA-022 | 4-2 | Plume-4 | 1.2 | 36 | 2,988 | 3.0 | 25 | <u>2,415</u> | 148 | 1.48 | 1,510 | 4 | 61.5 | 5,513 |
| FRA-023 | 4-3 | Plume-4 | 0.97 | 26 | 2,944 | 3 | 4.5 | 96 | 148 | 1.48 | 1,510 | 4.1 | 31.0 | 3102 |
| Plume Averages | | | 1.2 | 32 | 2,923 | 3.0 | 13 | 863 | — | — | — | 4.3 | 45.6 | 3,862 |
| FRA-025 | 5-1 | OTP 0–2 m | ND | 0.81 | 7.6 | ND | BQL | 4.5 | 103 | 1.03 | 435 | 0.00 | 0.34 | 5.12 |
| FRA-026 | 5-2 | OTP 0–2 m | ND | 0.82 | 8.2 | BQL | BQL | 5.4 | 100 | 1.00 | 435 | 0.00 | 0.36 | 5.87 |
| FRA-024 | 5-1 | Plume-5 | ND | 3.9 | 1,809 | ND | BQL | 1,014 | 100 | 1.00 | 1,400 | 0.0 | 5.5 | 3,952 |
| FRA-027 | 5-2 | Plume-5 | ND | 5.5 | 2,740 | ND | BQL | 660 | 103 | 1.03 | 1,400 | 0.0 | 7.5 | 4,621 |
| FRA-028 | 5-3 | Plume-5 | ND | 4.4 | 2,321 | ND | BQL | 1,266 | 103 | 1.03 | 1,400 | 0.0 | 5.9 | 4,875 |
| Plume Averages | | | — | 4.6 | 2,290 | — | — | 980 | — | — | — | 0.0 | 6.3 | 4,483 |
| FRA-029 | 6-1 | OTP 0–2 m | ND | 0.88 | 12 | BQL | BQL | 5.1 | 100 | 1.00 | 411 | 0.00 | 0.36 | 6.9 |
| FRA-030 | 6-2 | OTP 0–2 m | ND | 0.80 | 17 | BQL | ND | 8.2 | 100 | 1.00 | 411 | 0.00 | 0.33 | 10 |
| FRA-031 | 6-1 | Plume | ND | 18 | 2,851 | 3 | 10 | <u>8,610</u> | 105 | 1.05 | 1,240 | 3.5 | 33.3 | 13,535 |
| FRA-032 | 6-2 | Plume | ND | 21 | 2,394 | 4.3 | 8.4 | 1,062 | 105 | 1.05 | 1,240 | 5.1 | 34.7 | 4,081 |
| FRA-033 | 6-3 | Plume | 0.79 | 23 | 3,062 | 3 | 14 | 1,347 | 105 | 1.05 | 1,240 | 4.5 | 43.2 | 5,207 |
| Plume Averages | | | — | 20.7 | 2,769 | 3.4 | 11 | 3,673 | — | — | — | 4.4 | 37.1 | 7,608 |
| FRA-034 | 7-1 | OTP 0–2 m | ND | BQL | 13 | ND | ND | 2.4 | 63 | 0.63 | 465 | 0.00 | 0.00 | 11 |
| FRA-035 | 7-2 | OTP 0–2 m | ND | BQL | 184 | ND | ND | 2.4 | 63 | 0.63 | 465 | 0.00 | 0.00 | 138 |
| FRA-042 | 7-1 | Plume | ND | 6.4 | 2,140 | BQL | 8.8 | 355 | 123 | 1.23 | 1,440 | 0.0 | 17.7 | 2,921 |
| FRA-043 | 7-2 | Plume | ND | 7.2 | 2,822 | BQL | 8.0 | 1,290 | 123 | 1.23 | 1,440 | 0.0 | 17.8 | 4,815 |
| FRA-044 | 7-3 | Plume | ND | 6.0 | 2,156 | BQL | 6 | 323 | 123 | 1.23 | 1,440 | 0.0 | 14.0 | 2,902 |
| Plume Averages | | | — | 6.5 | 2,373 | — | 7.6 | 656 | — | — | — | 0.0 | 16.5 | 3,546 |

Table B1 (cont'd). 120-mm Mortar BIP test data.

| Sample ID | Plume No. and Rep | Type | Snow Melt Analyte Mass (µg) | | | Filters Analyte Mass (µg) | | | No. of Increment | Area (m ²) Sampled | DU Area (m ²) | Total Mass (mg) | | |
|----------------|-------------------|------------|-----------------------------|------|-------|---------------------------|------|--------------|------------------|--------------------------------|---------------------------|-----------------|------|--------|
| | | | HMX | RDX | NG | HMX | RDX | NG | | | | HMX | RDX | NG |
| FRA-045 | 7-1 | Surf Plume | ND | 15 | 4,508 | BQL | 29 | <u>3,680</u> | 37 | 1.48 | 1,440 | 0.0 | 60.8 | 11,338 |
| FRA-046 | 7-2 | Surf Plume | ND | 10 | 4,193 | ND | 9 | 3,438 | 26 | 1.04 | 1,440 | 0.0 | 26.6 | 10,566 |
| FRA-048 | 7-3 | Surf Plume | ND | 10 | 1,726 | ND | 4 | 96 | 26 | 1.04 | 1,440 | 0.0 | 19.0 | 2,524 |
| Plume Averages | | | — | 11.6 | 3,476 | ND | 14.0 | 2,405 | — | — | — | 0.0 | 35.5 | 8,143 |
| FRA-036 | 7-1 | SS Plume | ND | ND | 14 | ND | ND | 30 | 37 | 0.37 | 1,440 | 0.0 | 0.0 | 169 |
| FRA-037 | 7-2 | SS Plume | ND | ND | 7.7 | ND | ND | 1.1 | 26 | 0.26 | 1,440 | 0.0 | 0.0 | 49 |
| FRA-041 | 7-3 | SS Plume | ND | ND | 11 | ND | ND | 4.5 | 26 | 0.26 | 1,440 | 0.0 | 0.0 | 85 |

Notes:

41 samples; 4,059 increments.

Italicized numbers are values at or near quantitation value limits (reported as value limit).

Underlined bold numbers represent high NG value that may be affecting HMX and RDX values.

ND, not detected (below detection limits of instrumentation); BQL, below quantitative limits (reported as zero).

Rep, repetition.

The minimum mass reported (mg) is computed by multiplying 5x the detection limit in the AcN extract (mg/L) times the volume of AcN used to extract the sample (quantitation mass limit).

Appendix C: 60-mm Data

Table C1 contains sampling data, analytical data, and final results for the 60-mm BIP test. Detection limits are 0.02 mg/L for RDX, HMX, and TNT and 0.05 mg/L for NG.

Table C1. 60-mm Mortar BIP test data.

| Sample ID | Plume No. and Rep | Type | Snow Melt Analyte Mass (µg) | | | | Filters Analyte Mass (µg) | | | No. of Increment | Area (m ²) Sampled | DU Area (m ²) | Total Mass (mg) | | | |
|----------------|-------------------|---------------|-----------------------------|-----|-----|------|---------------------------|-----|------|------------------|--------------------------------|---------------------------|-----------------|-----|-----|-----|
| | | | HMX | RDX | TNT | NG | HMX | RDX | NG | | | | HMX | RDX | TNT | NG |
| FRA-049 | 1-1 | OTP 0–2 m | ND | BQL | ND | ND | ND | BQL | ND | 100 | 1.00 | 199 | 0.0 | 0.0 | 0.0 | 0.0 |
| FRA-050 | 1-2 | OTP 0–2 m | ND | BQL | ND | ND | ND | ND | BQL | 100 | 1.00 | 199 | 0.0 | 0.0 | 0.0 | 0.0 |
| FRA-051 | 1-1 | Plume-1 | BQL | 26 | ND | 132 | 7.8 | 37 | 166 | 80 | 0.80 | 480 | 4.7 | 38 | 0.0 | 180 |
| FRA-052 | 1-2 | Plume-1 | BQL | 22 | ND | 140 | 7.7 | 27 | 234 | 80 | 0.80 | 480 | 4.6 | 29 | 0.0 | 220 |
| FRA-053 | 1-3 | Plume-1 | BQL | 20 | ND | 112 | 5.6 | 29 | 214 | 80 | 0.80 | 480 | 3.3 | 29 | 0.0 | 190 |
| Plume Averages | | | — | 23 | — | 128 | 7.0 | 31 | 205 | — | — | — | 4.2 | 32 | 0 | 200 |
| FRA-054 | 2-1 | OTP 0–2 m | ND | BQL | ND | BQL | ND | ND | BQL | 84 | 0.84 | 205 | 0.0 | 0.0 | 0.0 | 0.0 |
| FRA-055 | 2-2 | OTP 0–2 m | ND | BQL | ND | BQL | ND | BQL | ND | 84 | 0.84 | 205 | 0.0 | 0.0 | 0.0 | 0.0 |
| FRA-056 | Light-1 | Plume-2-Light | ND | 8.2 | ND | 19.3 | ND | 6.7 | 29 | 53 | 0.53 | 290 | 0.0 | 8.1 | 0.0 | 26 |
| FRA-057 | Light-2 | Plume-2-Light | ND | 10 | ND | 10.0 | ND | 6.7 | 9.8 | 53 | 0.53 | 290 | 0.0 | 9.4 | 0.0 | 11 |
| FRA-061 | Med-1 | Pl.-2-Med | ND | 60 | ND | 382 | 14 | 92 | 735 | 87 | 0.87 | 150 | 2.3 | 26 | 0.0 | 190 |
| FRA-062 | Med-2 | Pl.-2-Med | ND | 56 | ND | 379 | 18 | 65 | 813 | 87 | 0.87 | 150 | 3.1 | 21 | 0.0 | 210 |
| FRA-063 | Dark-1 | Plume-2-Dark | 4.8 | 121 | ND | 563 | 50 | 224 | 1008 | 41 | 0.41 | 27 | 3.6 | 23 | 0.0 | 100 |
| FRA-064 | Dark-2 | Plume-2-Dark | 4.5 | 127 | ND | 549 | 44 | 179 | 976 | 41 | 0.41 | 27 | 3.2 | 20 | 0.0 | 100 |
| FRA-067 | 2-1 | Plume-2 | 3.2 | 50 | ND | 143 | 11 | 31 | 240 | 85 | 0.85 | 470 | 7.6 | 45 | 0.0 | 210 |
| FRA-068 | 2-2 | Plume-2 | 4.3 | 63 | ND | 207 | 13 | 31 | 270 | 85 | 0.85 | 470 | 9.8 | 52 | 0.0 | 260 |
| FRA-069 | 2-3 | Plume-2 | 3.9 | 62 | ND | 205 | 16 | 27 | 223 | 83 | 0.83 | 470 | 11 | 50 | 0.0 | 240 |
| Plume Averages | | | 3.8 | 58 | | 185 | 13 | 29 | 244 | — | — | — | 9.6 | 49 | — | 240 |

Table C1 (cont'd). 60-mm Mortar BIP test data.

| Sample ID | Plume No. and Rep | Type | Snow Melt Analyte Mass (µg) | | | | Filters Analyte Mass (µg) | | | No. of Increment | Area (m ²) Sampled | DU Area (m ²) | Total Mass (mg) | | | |
|----------------|-------------------|-----------|-----------------------------|------------|------------|------------|---------------------------|------------|------------|------------------|--------------------------------|---------------------------|-----------------|------------|------------|------------|
| | | | HMX | RDX | TNT | NG | HMX | RDX | NG | | | | HMX | RDX | TNT | NG |
| FRA-070 | 3-1 | OTP 0–2 m | BQL | 1.4 | ND | ND | ND | ND | ND | 95 | 0.95 | 291 | 0.0 | 0.43 | 0.0 | 0.0 |
| FRA-071 | 3-2 | OTP 0–2 m | BQL | 2.7 | ND | ND | ND | ND | ND | 95 | 0.95 | 291 | 0.0 | 0.82 | 0.0 | 0.0 |
| FRA-072 | 3-1 | Plume-3 | 8.1 | 245 | (8.2) | 138 | 73 | 424 | 272 | 100 | 1.00 | 620 | 50 | 410 | 5.1 | 260 |
| FRA-073 | 3-2 | Plume-3 | 9.2 | 254 | (3.3) | 157 | 54 | 298 | 191 | 100 | 1.00 | 620 | 39 | 340 | 2.0 | 220 |
| FRA-074 | 3-3 | Plume-3 | 5.4 | 196 | (2.8) | 134 | 92 | 516 | 272 | 100 | 1.00 | 620 | 60 | 440 | 1.7 | 250 |
| Plume Averages | | | 7.6 | 231 | 4.8 | 143 | 73 | 413 | 245 | — | — | — | 50 | 400 | 3.0 | 240 |
| FRA-075 | 4-1 | OTP 0–2 m | BQL | 3.9 | BQL | BQL | BQL | 5.0 | BQL | 87 | 0.87 | 196 | 0.0 | 2.0 | 0.0 | 0.0 |
| FRA-076 | 4-2 | OTP 0–2 m | BQL | 3.2 | BQL | BQL | BQL | 2 | | 87 | 0.87 | 196 | 0.0 | 1.2 | 0.0 | 0.0 |
| FRA-077 | 4-1 | Plume-4 | 8.4 | 415 | (1.9) | 297 | 50 | 228 | 152 | 96 | 0.96 | 400 | 25 | 270 | 0.8 | 190 |
| FRA-081 | 4-2 | Plume-4 | 9.9 | 434 | (1.3) | 237 | 49 | 216 | 126 | 96 | 0.96 | 400 | 24 | 270 | 0.6 | 150 |
| FRA-082 | 4-3 | Plume-4 | 5.0 | 286 | (1.3) | 187 | 72 | 365 | 228 | 96 | 0.96 | 400 | 32 | 270 | 0.5 | 170 |
| Plume Averages | | | 7.8 | 378 | 1.5 | 240 | 57 | 270 | 169 | — | — | — | 27 | 270 | 0.6 | 170 |
| FRA-083 | 5-1 | OTP 0–2 m | BQL | 2.8 | BQL | BQL | ND | 3.3 | ND | 89 | 0.89 | 243 | 0.0 | 1.65 | 0.0 | 0.0 |
| FRA-084 | 5-2 | OTP 0–2 m | BQL | 3.3 | BQL | ND | BQL | 3.0 | ND | 89 | 0.89 | 243 | 0.0 | 1.70 | 0.0 | 0.0 |
| FRA-085 | 5-1 | Plume-5 | 22 | 413 | (11) | 358 | 76 | 241 | 567 | 107 | 1.07 | 500 | 46 | 300 | 5.1 | 430 |
| FRA-086 | 5-2 | Plume-5 | 13 | 233 | (9.2) | 352 | 48 | 89 | 83 | 107 | 1.07 | 500 | 28 | 150 | 4.3 | 200 |
| FRA-087 | 5-3 | Plume-5 | 16 | 311 | (9.1) | 366 | 59 | 137 | 149 | 107 | 1.07 | 500 | 35 | 210 | 4.2 | 240 |
| Plume Averages | | | 17 | 319 | 10 | 359 | 61 | 156 | 266 | — | — | — | 36 | 220 | 4.5 | 290 |
| FRA-088 | 6-1 | OTP 0–2 m | ND | BQL | ND | ND | ND | ND | BQL | 83 | 0.83 | 271 | 0.0 | 0.0 | 0.0 | 0.0 |
| FRA-089 | 6-2 | OTP 0–2 m | ND | BQL | ND | ND | ND | BQL | BQL | 83 | 0.83 | 271 | 0.0 | 0.0 | 0.0 | 0.0 |
| FRA-090 | 6-1 | Plume-6 | BQL | 22 | ND | 160 | 4.9 | 19 | 174 | 98 | 0.98 | 600 | 3.0 | 25 | 0.0 | 200 |
| FRA-091 | 6-2 | Plume-6 | BQL | 20 | ND | 161 | 8.3 | 29 | 290 | 98 | 0.98 | 600 | 5.1 | 30 | 0.0 | 280 |
| FRA-093 | 6-3 | Plume-6 | BQL | 22 | ND | 165 | 6.9 | 25 | 192 | 80 | 0.80 | 600 | 5.2 | 35 | 0.0 | 270 |
| Plume Averages | | | — | 21 | — | 162 | 6.7 | 24 | 219 | — | — | — | 4.4 | 30 | — | 250 |

Table C1 (cont'd). 60-mm Mortar BIP test data.

| Sample ID | Plume No. and Rep | Type | Snow Melt Analyte Mass (µg) | | | | Filters Analyte Mass (µg) | | | No. of Increment | Area (m ²) Sampled | DU Area (m ²) | Total Mass (mg) | | | |
|-----------------------|-------------------|------------|-----------------------------|------------|------------|------------|---------------------------|------------|------------|------------------|--------------------------------|---------------------------|-----------------|------------|------------|-------------|
| | | | HMX | RDX | TNT | NG | HMX | RDX | NG | | | | HMX | RDX | TNT | NG |
| FRA-092 | 7-1 | OTP 0–2 m | ND | 4.5 | (1.6) | ND | 2 | 7.2 | BQL | 98 | 0.98 | 216 | 0.44 | 2.6 | 0.35 | 0.0 |
| FRA-094 | 7-2 | OTP 0–2 m | ND | 4.9 | (1.0) | ND | 3.0 | 11 | BQL | 80 | 0.80 | 216 | 0.81 | 4.2 | 0.27 | 0.0 |
| FRA-101 | 7-1 | Plume-7 | 4.3 | 166 | (3.2) | 191 | 45 | 330 | 360 | 100 | 1.00 | 430 | 21 | 210 | 1.4 | 240 |
| FRA-102 | 7-2 | Plume-7 | 4.6 | 177 | (2.0) | 183 | 38 | 302 | 290 | 100 | 1.00 | 430 | 18 | 210 | 0.8 | 200 |
| FRA-103 | 7-3 | Plume-7 | 4.1 | 167 | (3.4) | 225 | 41 | 375 | 354 | 100 | 1.00 | 430 | 19 | 230 | 1.5 | 250 |
| Plume Averages | | | 4.3 | 170 | 2.8 | 199 | 41 | 336 | 335 | — | — | — | 20 | 220 | 1.2 | 230 |
| FRA-104 | 7-1 | Surf P-7 | 9.4 | 260 | (5.1) | 267 | 43 | 636 | 354 | 27 | 1.08 | 430 | 21 | 360 | 2.0 | 250 |
| FRA-105 | 7-2 | Surf P-7 | 4.7 | 184 | (2.3) | 170 | 51 | 429 | 309 | 26 | 1.04 | 430 | 23 | 250 | 1.0 | 200 |
| FRA-106 | 7-3 | Surf P-7 | 3.3 | 138 | (1.4) | 142 | 39 | 250 | 227 | 26 | 1.04 | 430 | 18 | 160 | 0.6 | 150 |
| Plume Averages | | | 5.8 | 194 | 2.9 | 193 | 45 | 438 | 297 | — | — | — | 21 | 260 | 1.2 | 200 |
| FRA-095 | 7-1 | SS Plume-7 | ND | 1.4 | ND | ND | ND | ND | ND | 27 | 0.27 | 430 | 0.0 | 2.2 | 0.0 | 0.0 |
| FRA-096 | 7-2 | SS Plume-7 | BQL | 0.5 | ND | 0.4 | ND | ND | ND | 26 | 0.26 | 430 | 0.0 | 0.8 | 0.0 | 0.6 |
| FRA-097 | 7-3 | SS Plume-7 | BQL | 0.5 | ND | ND | ND | ND | ND | 26 | 0.26 | 430 | 0.0 | 0.8 | 0.0 | 0.0 |
| Plume Averages | | | — | 1 | — | 0.4 | — | — | — | — | — | — | — | 1.3 | — | 0.21 |

Notes:

47 samples; 3,752 increments.

Rep, repetition.

ND, not detected (below detection limits of instrumentation); BQL, below quantitation limits (values reported as zero).

Values in parentheses are estimated TNT concentrations.

Italicized numbers are values at or near quantitation value limits (reported as value limit).

Underlined bold numbers represent abnormal NG value that may be affecting HMX and RDX values.

The minimum mass reported (mg) is computed by multiplying 5x the detection limit in the AcN extract (mg/L) times the volume of AcN used to extract the sample (quantitation mass limit).

Appendix D: Laboratory QA Data

Table D1 contains data derived from laboratory quality assurance runs. Detection limits are 0.02 mg/L for RDX, HMX, and TNT and 0.05 mg/L for NG. The background sample had no detectable (ND) quantities of explosives in it. A small amount of NG was recovered from the filter of Water Blank-2. The source of this contamination was not traceable.

Table D1. Quality assurance data.

| Sample ID | Description | Water Concentrations mg/L | | | | Filter Concentrations mg/L | | | | Target Concentrations (mg/L) | | | |
|------------------------------|------------------|---------------------------|-------------|-------------|-------------|----------------------------|-------|-------|-------------|------------------------------|-------------|-------------|-------------|
| | | HMX | RDX | TNT | NG | HMX | RDX | TNT | NG | HMX | RDX | TNT | NG |
| FRA-018 | Water Blank-1 | <0.02 | <0.02 | — | <0.050 | <0.02 | <0.02 | <0.02 | <0.05 | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-019 | SPE Blank-1 | <0.02 | <0.02 | — | <0.050 | — | — | — | — | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-020 | SPE LCS-1 | 0.216 | 0.204 | — | 0.197 | — | — | — | — | 0.20 | 0.20 | 0.20 | 0.20 |
| FRA-038 | Water Blank-2 | <0.02 | <0.02 | — | <0.050 | <0.02 | <0.02 | <0.02 | 0.51 | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-039 | SPE Blank-2 | <0.02 | <0.02 | — | <0.050 | — | — | — | — | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-040 | SPE LCS-2 | 0.210 | 0.201 | — | 0.176 | — | — | — | — | 0.20 | 0.20 | 0.20 | 0.20 |
| FRA-058 | Water Blank-3 | <0.02 | <0.02 | <0.02 | <0.05 | <0.02 | <0.02 | <0.02 | <0.05 | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-059 | SPE Blank-3 | <0.02 | <0.02 | <0.02 | <0.05 | — | — | — | — | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-060 | SPE LCS-3 | 0.202 | 0.202 | 0.174 | 0.177 | — | — | — | — | 0.20 | 0.20 | 0.20 | 0.20 |
| FRA-078 | Water Blank-4 | <0.02 | <0.02 | <0.02 | <0.05 | <0.02 | <0.02 | <0.02 | <0.05 | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-079 | SPE Blank-4 | <0.02 | <0.02 | <0.02 | <0.05 | — | — | — | — | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-080 | SPE LCS-4 | 0.206 | 0.205 | 0.183 | 0.187 | — | — | — | — | 0.20 | 0.20 | 0.20 | 0.20 |
| FRA-098 | Water Blank-5 | <0.02 | <0.02 | <0.02 | <0.05 | <0.02 | <0.02 | <0.02 | <0.05 | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-099 | SPE Blank-5 | <0.02 | <0.02 | <0.02 | <0.05 | — | — | — | — | <0.02 | <0.02 | <0.02 | <0.050 |
| FRA-100 | SPE LCS-5 | 0.216 | 0.195 | 0.182 | 0.204 | — | — | — | — | 0.20 | 0.20 | 0.20 | 0.20 |
| FRA-047 | Background | ND | ND | ND | ND | ND | ND | ND | ND | 0 | 0 | 0 | 0 |
| Averages for LCS runs | | 0.21 | 0.20 | 0.18 | 0.19 | — | — | — | — | 0.20 | 0.20 | 0.20 | 0.20 |

| REPORT DOCUMENTATION PAGE | | | | Form Approved OMB No. 0704-0188 | |
|---|-------------|------------------------------------|----------------------------|---|---|
| Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing this collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden to Department of Defense, Washington Headquarters Services, Directorate for Information Operations and Reports (0704-0188), 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302. Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number. PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ADDRESS. | | | | | |
| 1. REPORT DATE (DD-MM-YYYY) October 2008 | | 2. REPORT TYPE Technical Report | | 3. DATES COVERED (From - To) | |
| 4. TITLE AND SUBTITLE Energetic Residues from Blow-in-Place Detonation of 60-mm and 120-mm Fuzed High-Explosive Mortar Cartridges | | | | 5a. CONTRACT NUMBER | |
| | | | | 5b. GRANT NUMBER | |
| | | | | 5c. PROGRAM ELEMENT NUMBER | |
| 6. AUTHOR(S) Michael R. Walsh, Charles M. Collins, and Alan D. Hewitt | | | | 5d. PROJECT NUMBER | |
| | | | | 5e. TASK NUMBER | |
| | | | | 5f. WORK UNIT NUMBER | |
| 7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) U.S. Army Engineer Research and Development Center Cold Regions Research and Engineering Laboratory 72 Lyme Road Hanover, NH 03755-1290 | | | | 8. PERFORMING ORGANIZATION REPORT NUMBER ERDC/CRREL TR-08-19 | |
| 9. SPONSORING / MONITORING AGENCY NAME(S) AND ADDRESS(ES) U.S. Army Garrison, Alaska, Soil and Water Monitoring Program | | | | 10. SPONSOR/MONITOR'S ACRONYM(S) | |
| | | | | 11. SPONSOR/MONITOR'S REPORT NUMBER(S) | |
| 12. DISTRIBUTION / AVAILABILITY STATEMENT Approved for public release; distribution is unlimited. | | | | | |
| 13. SUPPLEMENTARY NOTES | | | | | |
| 14. ABSTRACT Military live-fire training missions frequently result in unexploded ordnance on training ranges. Disposal of the rounds, often done in situ, is necessary in some cases for range safety or maintenance. In February 2008, the U.S. Army Cold Regions Research and Engineering Laboratory teamed with the 716 th Explosive Ordnance Disposal detachment at Fort Richardson, Alaska, to detonate two series of seven 60-mm and 120-mm fuzed high-explosive (HE) rounds to determine the resulting energetic residues. Each round was detonated using a single block of C4 (91% RDX) as a donor charge. All rounds were separated to allow each detonation plume to be sampled as a distinct decision unit. Samples were collected from the snow surface using multi-increment sampling for residues analysis. The 60-mm plumes averaged 200 mg of HE, 0.022% of the original mass. The 120-mm plumes averaged 25 mg of HE, 7.1 x 10 ⁻⁴ % of the original mass. Quality assurance procedures were conducted both in the field and at the laboratory to ensure data fidelity. | | | | | |
| 15. SUBJECT TERMS Propellants, Energetics, Residues, Mortars, High Explosives, Blow-in-Place, Impact Areas, Snow, Ice, Multi-Increment Sampling | | | | | |
| 16. SECURITY CLASSIFICATION OF: | | | 17. LIMITATION OF ABSTRACT | 18. NUMBER OF PAGES | 19a. NAME OF RESPONSIBLE PERSON |
| a. REPORT | b. ABSTRACT | c. THIS PAGE | | | 19b. TELEPHONE NUMBER (include area code) |
| U | U | U | U | 37 | |